

**PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA)**  
**CONTRACT AWARD PROFORMA – I**

To Be Filled and Uploaded on PPRA Website in Respect of All Public Contracts of Works, Services and Goods Worth Fifty Million or More

➤	NAME OF THE ORGANIZATION/DEPTT:	<u>WAPDA (Power Station Tarbela)</u>
➤	FEDERAL / PROVINCIAL GOVT:	<u>FEDERAL GOVT.</u>
➤	TITLE OF CONTRACT:	Supply, Installation, Testing and Commissioning of Numerical type Distance Protection Relays (Main-I type SEL 421; Main-II type MICOM P446), Overcurrent & Earth Fault Protection Relays (Type SEL 751) and Circuit Breaker Failure Protection Relays (Type SEL 751) and all other accessories as per Tender requirement for 500KV & 220KV Transmission Lines emanating from Switchyard of Tarbela Power Station.
➤	TENDER NUMBER:	<u>Tender No. 704</u>
➤	BRIEF DESCRIPTION OF CONTRACT:	Supply, Installation, Testing and Commissioning of Numerical type Distance Protection Relays (Main-I type SEL 421; Main-II type MICOM P446), Overcurrent & Earth Fault Protection Relays (Type SEL 751) and Circuit Breaker Failure Protection Relays (Type SEL 751) and all other accessories as per Tender requirement for 500KV & 220KV Transmission Lines emanating from Switchyard of Tarbela Power Station
➤	TENDER VALUE	<u>PKR 150.00 (Million)</u>
➤	ENGINEER'S ESTIMATE (for civil Works only)	<u>N.A</u>
➤	ESTIMATED COMPLETION PERIOD	Supply of Goods : 132 Days <u>Site Installation/Services : 105 Days</u>
➤	WHETHER THE PROCUREMENT WAS INCLUDED IN ANNUAL PROCUREMENT PLAN?	<u>Yes</u>
➤	ADVERTISEMENT: (i) PPRA Website (ii) News Papers	(i) <u>Yes, PPRA Ref No. TS468394E</u> (ii) <u>Yes, Daily Jang on 25-12-2021</u>
➤	TENDER OPENED ON (DATE & TIME)	<u>25-01-2022 at 11:30 Hrs.</u>
➤	NATURE OF PURCHASE	<u>F.C.S.</u>
➤	EXTENSION IN DUE DATE (If any)	<u>Yes (25-01-2022)</u>
➤	NUMBER OF TENDER DOCUMENTS SOLD (Attach list of Buyers)	<u>12 Nos.</u>
➤	WHETHER QUALIFICATION CRITERIA WAS INCLUDED IN BIDDING/TENDER DOCUMENTS (If yes enclose a copy).	<u>Yes</u>
➤	WHETHER BID EVALUATION CRITERIA WAS INCLUDED IN BIDDING/TENDER DOCUMENTS (If yes enclose a copy).	<u>Yes</u>
➤	WHICH METHOD OF PROCUREMENT WAS USED: - (Tick one)	

5 wapda 23922. per

a) SINGLE STAGE – ONE ENVELOPE PROCEDURE \_\_\_\_\_

b) SINGLE STAGE - TWO ENVELOPE PROCEDURE. \_\_\_\_\_

c) TWO STAGE BIDDING PROCEDURE. \_\_\_\_\_

d) TWO STAGE – TWO ENVELOPE BIDDING PROCEDURE:

- PLEASE SPECIFY IF ANY OTHER METHOD OF PROCUREMENT WAS ADOPTED WITH BRIEF REASONS (i.e EMERGENCY, DIRECT CONTRACTING, NEGOTIATED TENDERING ETC.)

- WHO IS THE APPROVING AUTHORITY Chief Engineer (Power), Tarbela

➤	WHETHER APPROVAL OF COMPETENT AUTHORITY WAS OBTAINED FOR USING A METHOD OTHER THAN OPEN COMPETITIVE BIDDING.	<u>N.A</u>
➤	NUMBER OF BIDS RECEIVED	<u>05 Nos.</u>
➤	WHETHER THE SUCCESSFUL BIDDER WAS LOWEST BIDDER	<u>Yes</u>
➤	WHETHER INTEGRITY PACT WAS SIGNED	<u>Yes</u>

**PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA)**  
**CONTRACT AWARD PROFORMA – II**


To Be Filled And Uploaded on PPRA Website In Respect of All Public Contracts of Works, Services & Goods Worth Fifty Million Rupees or More

➤	NUMBER OF BIDDERS PRESENT AT THE TIME OF OPENING OF BIDS	<u>05 (Five)</u>
➤	NAME AND ADDRESS OF THE SUCCESSFUL BIDDER:	<u>M/s Pak Elektron Limited (PEL), 14km, Ferozpur Road, Lahore-54760</u>
➤	RANKING OF SUCCESSFUL BIDDER IN EVALUATION REPORT (i.e. 1 <sup>st</sup> , 2 <sup>nd</sup> , 3 <sup>rd</sup> EVALUATED BID).	<u>1<sup>st</sup> lowest</u>
➤	NEED ANALYSIS (Why the procurement was necessary?)	<u>The Procurement was necessary for reliable, safe operation &amp; protection of 500KV &amp; 220KV Transmission Lines</u>
➤	IN CASE EXTENSION WAS MADE IN RESPONSE TIME, WHAT WERE THE REASONS (Briefly describe)	<u>N.A</u>
➤	WHETHER NAMES OF THE BIDDERS AND THEIR PRICES WERE READ OUT AT THE TIME OF OPENING OF BIDS	<u>Yes</u>
➤	DATE OF CONTRACT SIGNING (Attach a copy of agreement)	<u>15-09-2022</u>
➤	CONTRACT AWARD PRICE	<u>PKR 100,683,460/-</u>
➤	WHETHER COPY OF EVALUATION REPORT GIVEN TO ALL BIDDERS (Attach copy of the bid evaluation report)	<u>Yes</u>
➤	ANY COMPLAINTS RECEIVED (If yes result thereof)	<u>No</u>
➤	ANY DEVIATION FROM SPECIFICATIONS GIVEN IN THE TENDER NOTICE/DOCUMENTS (If yes give details)	<u>No</u>
➤	DEVIATION FROM QUALIFICATION CRITERIA (If yes give details)	<u>No</u>
➤	SPECIAL CONDITIONS, IF Any (Give Brief Description)	<u>No</u>



PAKISTAN  
WATER AND POWER DEVELOPMENT AUTHORITY

**TARBELA POWER STATION**

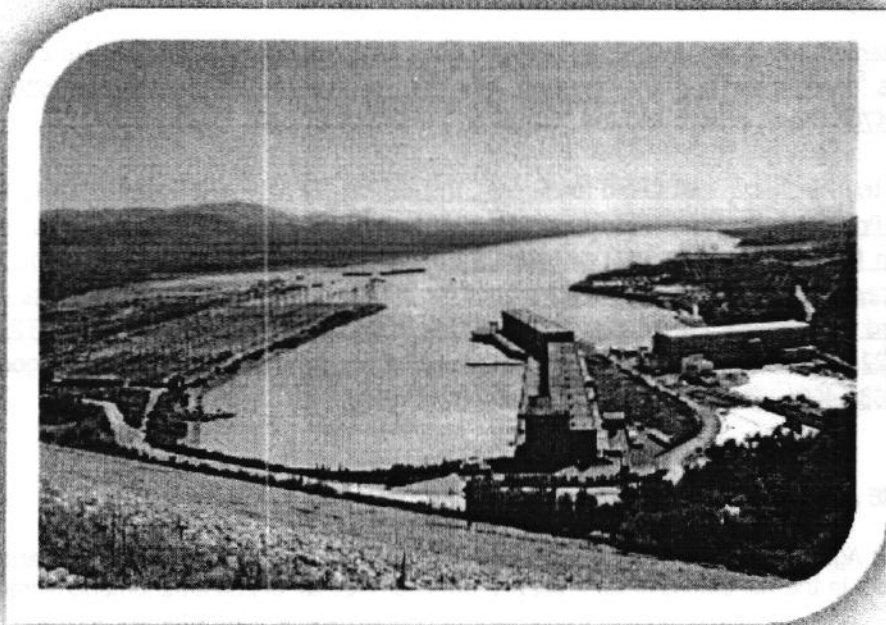

**CONTRACT AGREEMENT**

FOR

SUPPLY, INSTALLATION, TESTING AND COMMISSIONING OF  
NUMERICAL TYPE DISTANCE PROTECTION RELAYS, OVERCURRENT &  
EARTH FAULT PROTECTION RELAYS AND CIRCUIT BREAKER FAILURE  
PROTECTION RELAYS FOR 550KV & 220KV TRANSMISSION LINES  
EMANATING FROM SWITCHYARD

ON

**F.C.S. BASIS**

**CONTRACT NO. C-544 DATED 15/09/2022**

OFFICE OF THE CHIEF ENGINEER (POWER)  
HYDEL POWER STATION, TARBELA DAM  
TEHSIL & DISTRICT : SWABI, KHYBER PAKHTUNKHWA,  
PAKISTAN, POST CODE : 23470  
PH: +92 938 281180-82  
FAX: +92 938 281186  
EMAIL : cetarbelapower@gmail.com